


SINGLE DUCT TERMINAL UNIT WITH HOT WATER HEATING COIL LSW

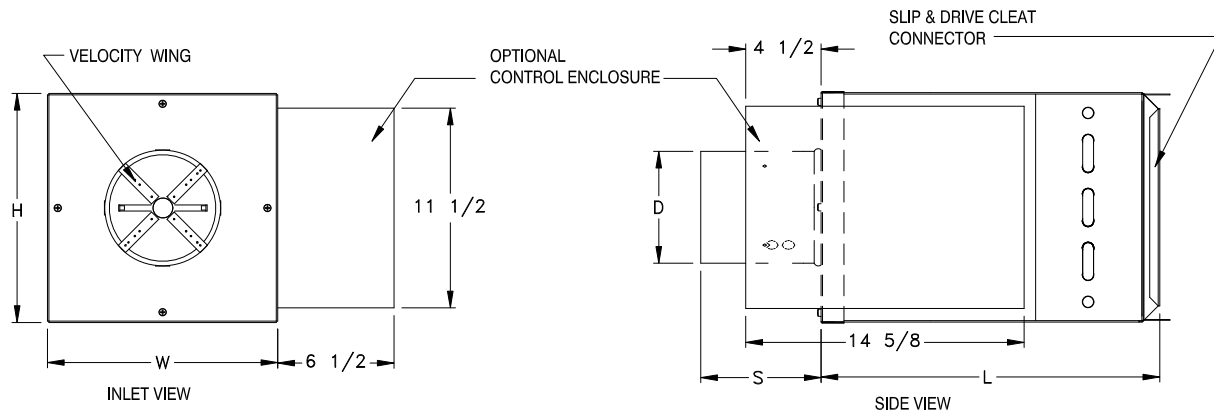


SIZE	D	W	H	1 ROW		2 ROW		4 ROW		S
				L	WGHT	L	WGHT	L	WGHT	
05	4 7/8	10	10	16 1/4	13 LBS	17 5/16	15 LBS	19 7/16	19 LBS	5 3/8
06	5 7/8	10	10	16 1/4	13 LBS	17 5/16	15 LBS	19 7/16	19 LBS	5 3/8
07	6 7/8	12	10	16 1/4	16 LBS	17 5/16	18 LBS	19 7/16	23 LBS	5 3/8
08	7 7/8	12	10	16 1/4	16 LBS	17 5/16	18 LBS	19 7/16	23 LBS	5 3/8
09	8 7/8	14	12 1/2	18 1/4	21 LBS	19 5/16	24 LBS	21 7/16	31 LBS	5 3/8
10	9 7/8	14	12 1/2	18 1/4	21 LBS	19 5/16	24 LBS	21 7/16	31 LBS	5 3/8
12	11 7/8	16	15	22 1/4	26 LBS	23 5/16	31 LBS	25 7/16	39 LBS	5 3/8
14	13 7/8	20	17 1/2	22 1/4	32 LBS	23 5/16	38 LBS	25 7/16	50 LBS	5 3/8
16	15 7/8	24	17 1/2	22 1/4	39 LBS	23 5/16	45 LBS	25 7/16	59 LBS	5 3/8
24	24 x 16	38	18	33 3/4	97 LBS	34 13/16	104 LBS	36 15/16	123 LBS	5 7/16

NOTES:

- WEIGHT ARE AN ESTIMATION AND WILL VARY BASED ON SELECTED OPTIONS, INSULATION TYPE, ETC.
- 36" CLEARANCE REQUIRED BY NEC FOR ELECTRICAL ENCLOSURES.

STANDARD FEATURES:

- PERFORMANCE CERTIFIED UNDER ARI STANDARDS 880 AND 410.
- HEAVY GAUGE ZINC COATED STEEL, MECHANICAL LOCKING SEAMS CONSTRUCTION.
- INSULATION MEETS REQUIREMENTS OF NFPA AND UL.
 - STANDARD 1" THICK MATTE-FACED DUAL DENSITY GLASS FIBER INSULATION
 - 3/8" CLOSED CELL "HOSPITAL" GRADE INSULATION
 - METAL LINER DOUBLE WALL CONSTRUCTION
 - FIBER-LOK
- ROUND DAMPER WITH LEAK-RESISTANT PERIMETER SEAL.
- SLIP AND DRIVE CLEAT CONNECTIONS ON RECTANGULAR DISCHARGE.
- RIGHT OR LEFT HAND CONTROL LOCATION.
- MULTI - POINT CENTER AVERAGING AIR FLOW SENSOR USING LOG - LINEAR METHOD ADOPTED BY ARI AND AMCA.
- GAUGE TEES FOR AIR FLOW MEASUREMENT.
- 1/2" O.D COPPER TUBES.
- ALUMINUM CORRUGATED FINS, 10 PER INCH.
- CONNECTIONS:
 - SINGLE CIRCUIT - 1/2" O.D MALE SOLDER.
 - MULTI CIRCUIT - 7/8" O.D MALE SOLDER.
- ACTUATOR
- SOLID ONE PIECE DAMPER SHAFT.

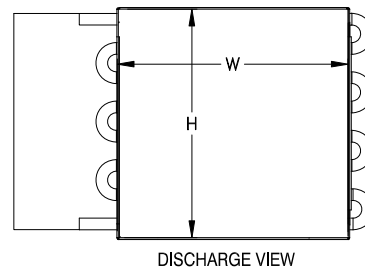

All Dimensions are in Inches



Laboratory Control Systems Incorporated
91 Quinton Road
Scott Township, PA 18447
Tel: 570.487.2490 Fax: 570.487.2494
www.labcontrols.com

Title:
SINGLE DUCT TERMINAL UNIT WITH HOT
WATER HEATING COIL

Model Number:
LSW

Drawing Number:
LSW-DS

Date:
02/05/2020

Rev: C